


# WATER TANKS

## INSTALLATION OF WATER TANKS:

1. TANKS MUST BE SET LEVEL ON A MINIMUM OF 4" OF SAND.
2. TANKS MUST BE BACK FILLED WITH SAND TO TOP OF TANK.
3. MINIMUM OF ONE FOOT AND A MAXIMUM OF FOUR FOOT COVER OVER TANK.
4. TANK MUST BE BACKFILLED AND ALLOWED 24 HOURS FOR HEAL TO CURE BEFORE ROLLING WITH TRACTOR.
5. DO NOT USE AS PRESSURE TANKS.

WE WILL SET TANKS WITHOUT THESE FOUR REQUIREMENTS, BUT ALL RESPONSIBILITY IS THAT OF THE BUYER.

CAPACITIES CAN BE INCREASED BY COUPLING TANKS TOGETHER (END TO END)

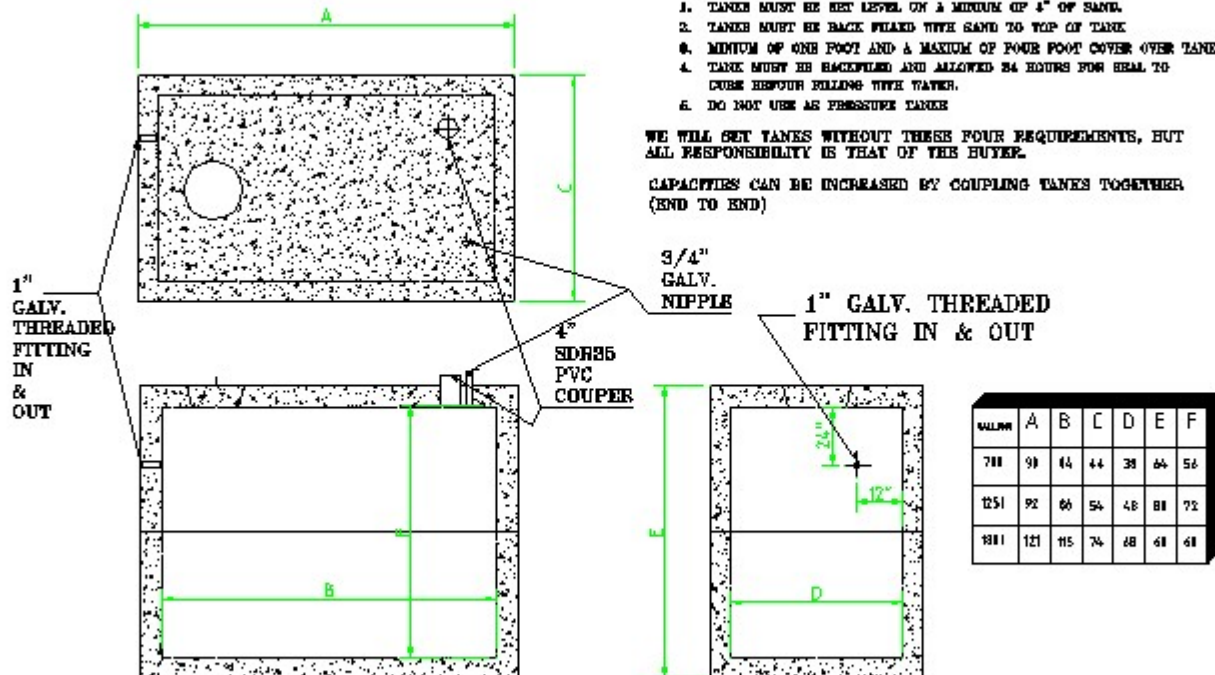

SERIAL	A	B	C	D	E	F
781	98	14	44	38	64	56
1251	92	66	54	48	88	72
881	121	115	74	68	68	68

REINFORCING: SSS10/10 (21#) WELDED WIRE MESH IN ALL WALLS, TOP, AND BOTTOM. ALL TANKS.

#3 (3/8") GRADE 60 RE-BARS ACROSS TOP AND BOTTOM OF ALL TANKS.

CONCRETE COMPRESSIVE STRENGTH 4000 P.S.I.

**HCP** HANNIBAL CONCRETE PRODUCTS CO.  
 600 RED DEVIL ROAD  
 HANNIBAL, MO 63401

MADE BY: MUEL SMITH    672-221-4846    DESIGNED BY: WATER TANK

REVISIONS	
BY	DATE